2

HILLSBOROUGH COUNTY
ENVIRONMENTAL PROTECTION COMMISSION

1900 9th Avenue
Tampa, Fla. 33605
272-5960

WATER QUALITY REPORT

sample taken by :	collection date - time :	sampling depth
E. Lesnett	8-9-84	grab

Location description : Lake Juanita
- Dr. Lampro residence at end of Tillotson Lane
- Refer to map for location

reason for sampling : Complaint of septic tank malfunctioning due to flooding next to lake

Parameter	Unit	Method	Value
Coli MF	#/100mls	31501	< 100
Fecal Coli MF	#/100mls	31616	< 100
Fecal Strep MF	#/100mls	31673	200
F Coli / F Strep	#	Ratio	—

Parameter	Unit	Method	Value

report prepared by : N. Roy date : 8-14-84

lab manager : Tom Cardinale T.C.

8-9-84

T 27 R 17 S 22

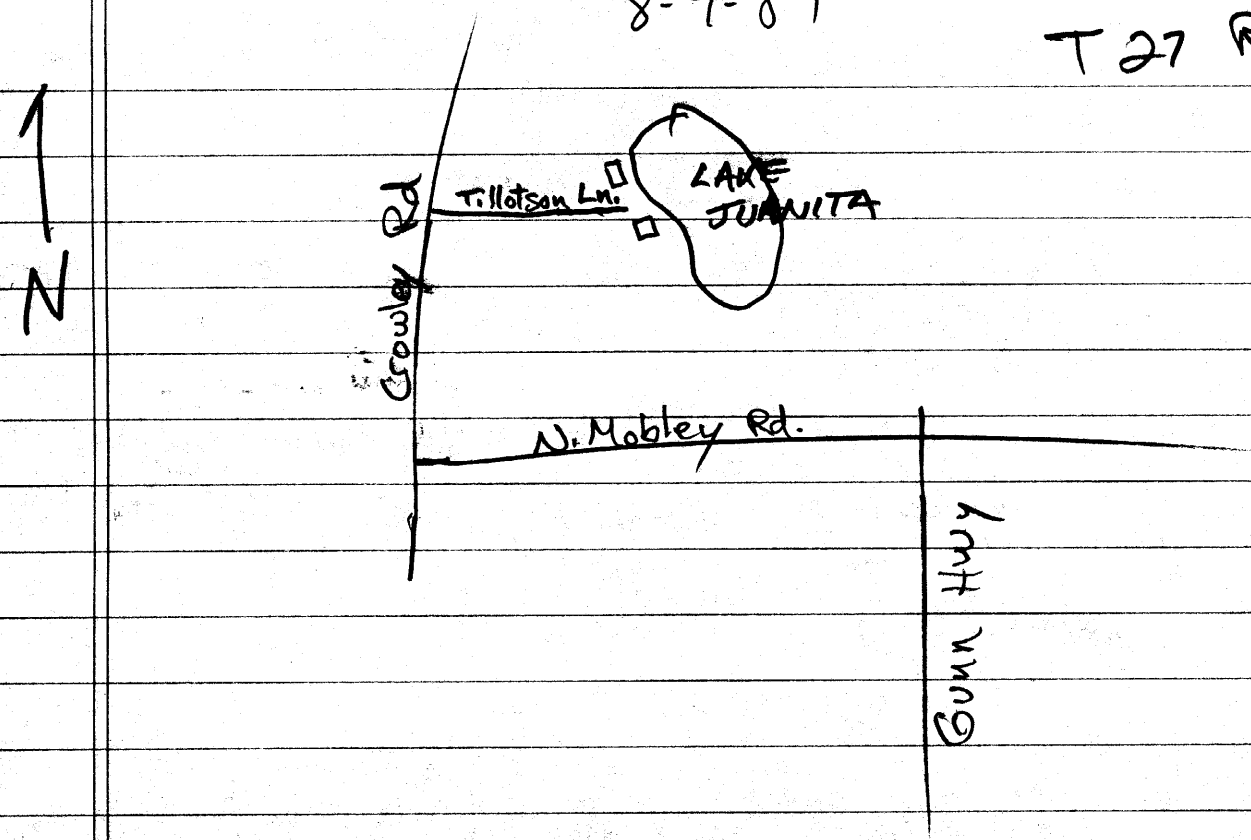

2

HILLSBOROUGH COUNTY ENVIRONMENTAL PROTECTION COMMISSION
BACTERIALOGICAL RESULTS
MEMBRANE FILTER DATA SHEET

Location Lake Juanita – Dr. Lampro residence at end of Tillotson lane
Collector(s) E. Leavell Coll. Date 8-9-87 Coll. Time —
Rec. by N.M. Rec. Date 8-9-87 Rec. Time 1400
Filtered by [illegible] Date filtered 8-9-87 Analyzed by [illegible] Date analyzed 8-10-87

Code: TNTC Too Numerous to Count; T Typical Colonies (indicator organism); AT Atypical Colonies (non-indicator organism); TAT Typical and Atypical Colonies; NC No Colonies; CG Confluent Growth

Odor ? —

24 hr. incub. time: In 1430 Out 1345
48 hr. incub. time: In. 1430 Out 1345

MF NO.	GROWTH MEDIUM	SAMPLE VOL. (ML)	COUNT (ind. org. only)	REMARKS
1	m-Enb	1.0	0	AT 3 AT colonies were purple
2	"	.1	0	AT
1	MFC	1.0	0	NC
2	"	.1	0	NC
1	RF-Stp	1.0	2	T
2	"	.1	1	T

Calculation: $\frac{\text{No. of Colonies of Indicator Organism}}{\text{No. of ml. of sample filtered}}$ X 100 = No. of colonies/100 ml sample

35.5 C. Total Coliform Count < 100 Colonies/100 ml
44.5 C. Fecal Coliform Count < 100 Colonies/100 ml
35.5 C. Fecal Strep Count 200 Colonies/100 ml

Ratio = $\frac{\text{Fecal Coliform}}{\text{Fecal Strep}}$ = NO RATIO